
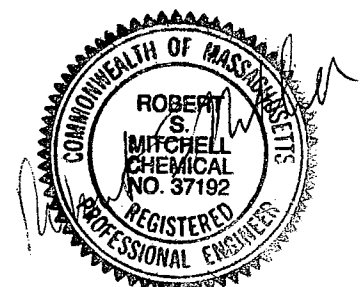


NOTES:
1. All equipment and instrumentation within box is by the Vendor. Diagram shows general scope for clarification purposes only. Refer to specification for more details on Vendor supply (i.e. additional instrumentation requirements).

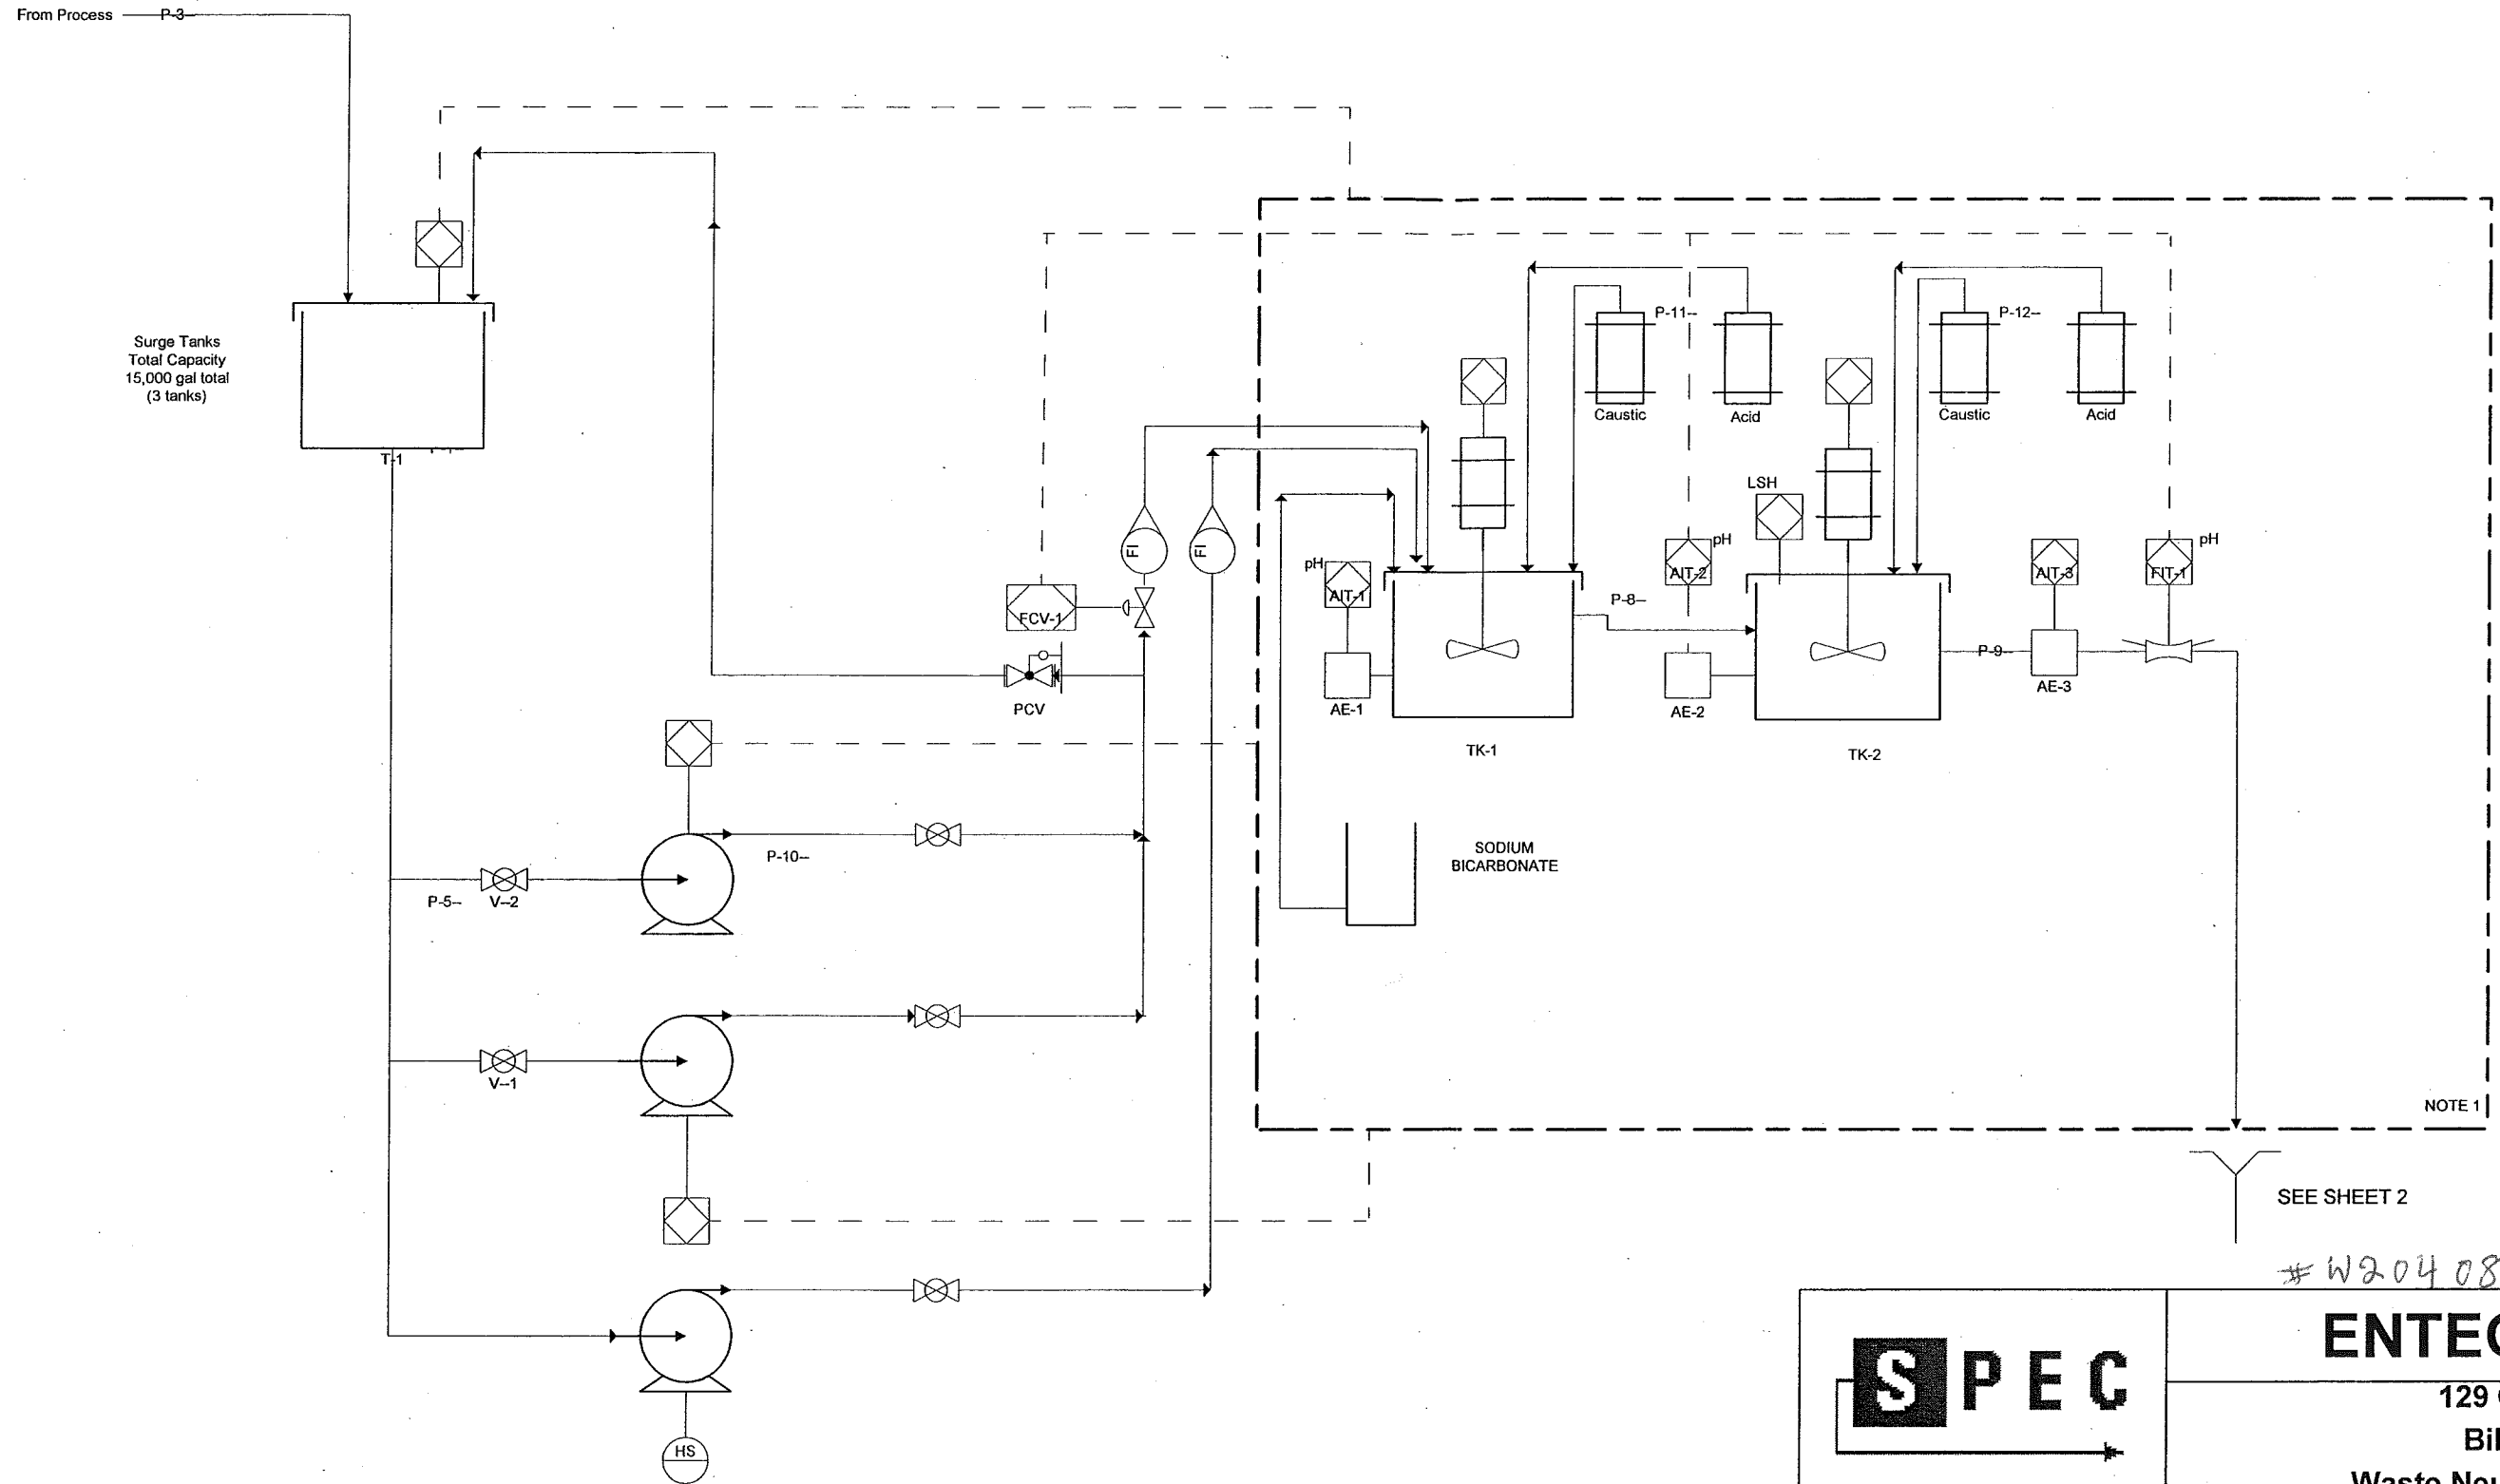

FULL FILENAME
P:\ENTEGRIS\0131PFD181712REVC.VSD


		ENTEGRIS, INC.		
		129 Concord Rd Billerica, MA Waste Neutralization System		
DRAWN BY R MITCHELL	SIZE	FSCM NO	DWG NO SK-PFD-01	REV C
DATE 1/25/08	SCALE None	SHEET 1 OF 2		

B


B

A

A

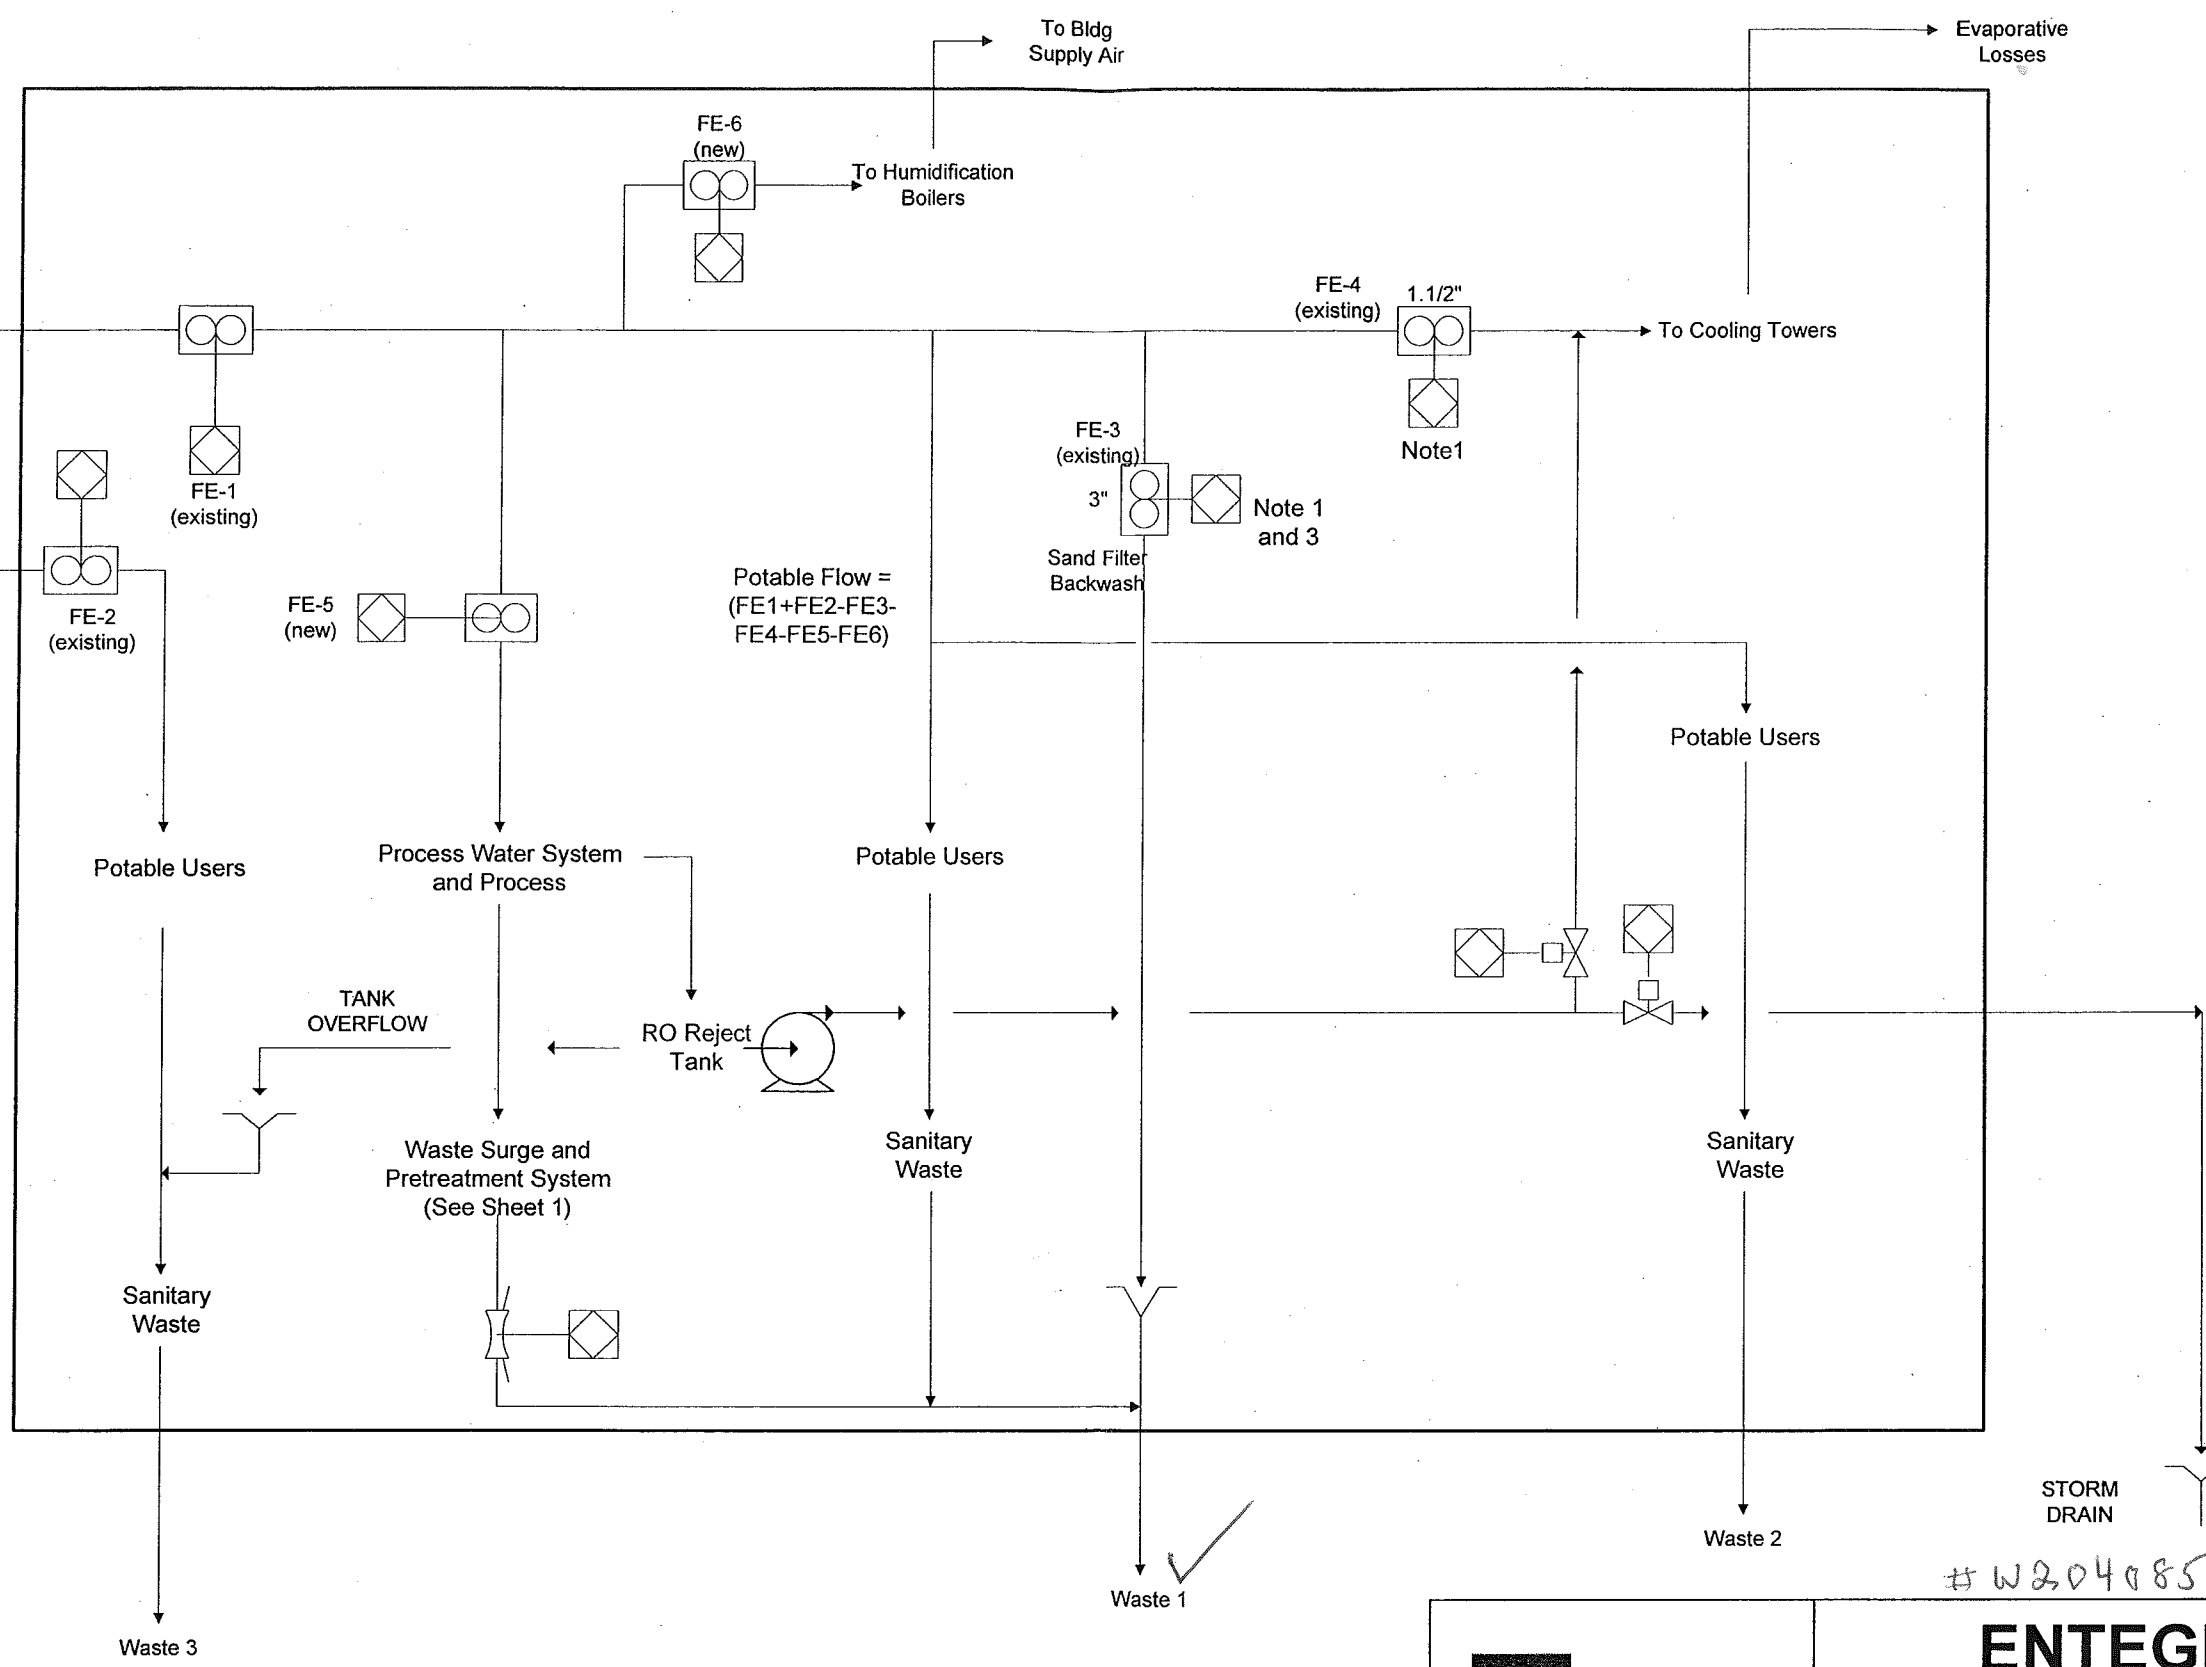

- NOTES:
1. Retrofit existing meter with transmitter.
 2. DELETED
 3. Stop Flow from Pre-Treatment System during Sand Filter Backwash. Program backwash during non-peak hours.

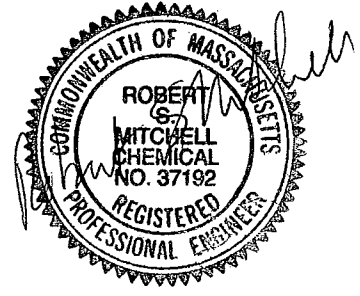

#W204085

FULL FILENAME
P:\ENTEGRIS\0131PFD181712REVC.VSD

		ENTEGRIS, INC.			
		129 Concord Rd Billerica, MA			
R MITCHELL		SIZE	FSCM NO	DWG NO	REV
1/25/08		SCALE	None	SK-PFD-02	C
		SHEET		R	